


SUPERVISORY CABLE 20x2x0.9

CROSS SECTION

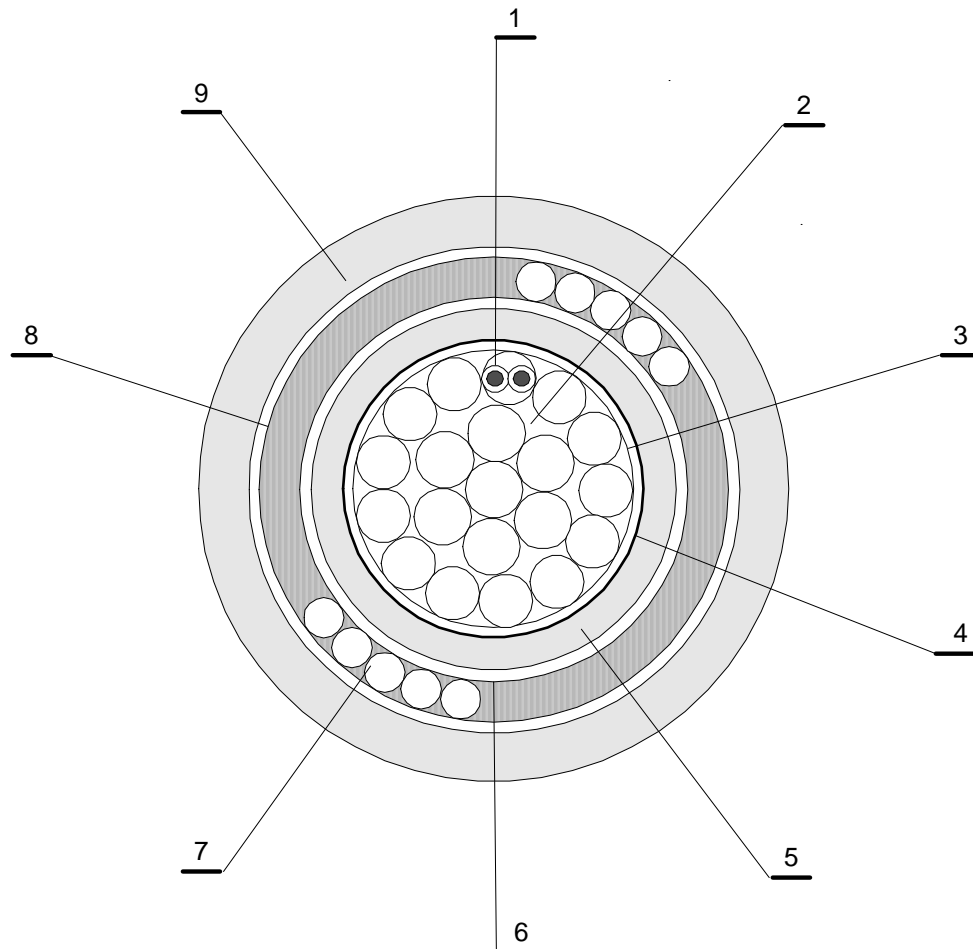

1. pairs with conductor 0.9 mm (1+6+13)
2. petroleum jelly acc to BS 3573 (filling)
3. polyester tape + poliester water-blocking tape
4. aluminium / polymer laminate tape , thickness of alluminium nominal 0.15 mm
5. black polyethylene sheath (BS 6234 type 03C) minimal thickness 1.4 mm
- 4+5 make moisture barrier
6. poliester water-blocking tape
7. screen of single layer of aluminium wires with diameter 2,3 mm , resistance max. 0,27 ohm/km
8. polyester tape
9. black PVC sheath acc to BS 6746 , min thickness 1,6 mm

List:	S.Durmiš B Sc.E.E.	Pregledao:	S. Durmiš B Sc.E.E.	Odobrio:	O.Gašpar B Sc.E.E.	List:	
Page:		Checked:		Approved by:		Page:	1
Constr.:		Datum:	11.10.2002.	Datum:	11.10.2002.	Listova:	
Datum:	11.10.2002.	Date:		Date:		Pages:	1